



Annual work report 2021

Offshore wind energy power plant

Nobelwind



Subject	Author	Reviewer	Approver	Date
Draft report	O&M	DVA/DVE	KVE	03/03/2022
Final report	O&M	DVA/DVE	KVE	18/05/2022

PUBLIC VERSION

Table of Contents

1. Purpose of the document	3
2. Introduction	3
3. Project overview.....	4
4. Wind farm annual operations information	6
4.1. Production.....	6
4.1.1. Performance of the wind farm.....	6
4.1.2. Wind rose	6
4.2. Planned maintenance.....	6
5. Environmental Research.....	8
6. Permit conditions	8
7. Operations Management.....	10
7.1. Health Safety and environment	10
7.1.1. Unwanted events over the reporting period	10
7.1.2. Proactive safety initiatives	10
7.1.3. Emergency exercises	11
7.1.4. Emergency actions (TIER2).....	11
7.1.5. Intrusions.....	11
7.2. Vessel & accessibility.....	12
7.3. O&M office Parkwind	12
8. Conclusion and outlook	12

1. Purpose of the document


The present report gives an overview of the main activities and relevant parameters of the Nobelwind offshore windfarm for the period as from 1 January 2021 up to 31 December 2021.

2. Introduction

The Nobelwind offshore wind farm is located on the Bligh Bank, part of the Belgian Continental Shelf within the Belgian Exclusive Economic zone. The distance from the wind farm to the nearest point at shore (Zeebrugge) is approximately 47 km. Other wind farm data can be found in Table 1.

Table 1: Wind Farm data


Quantity	50	#
Power wind turbine	3.3	MW
Wind farm power	165	MW
Offshore HV stations	1	#
Wind farm area	19,8	Km ²
Minimum seabed level depth, approx.	26	m LAT
Maximum seabed level depth, approx.	38	m LAT
Distance to the coast, approx.	47	km

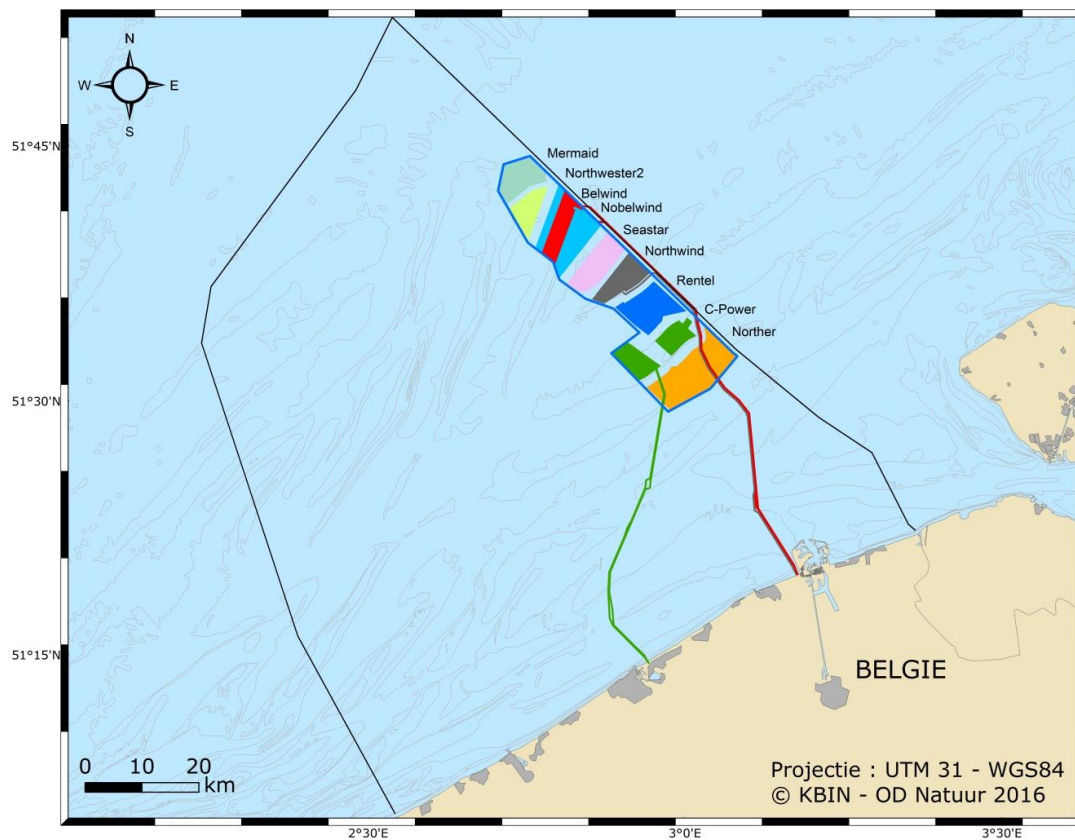

Location offshore wind farm Nobelwind


3. Project overview

The Bligh Bank offshore wind park zone is the initially Belwind concession zone, which has been split up into two separate concessions namely the Belwind and Nobelwind concession. In line with the Royal Decrees of 20 December 2000 (Domain concession), 12 March 2002 (Sea-cable permit) and 07 September 2003 (Marine environmental permit), the partial split of these initial permits has been applied for by Belwind and Nobelwind. Nobelwind obtained in 2015 the necessary authorization for its realization.

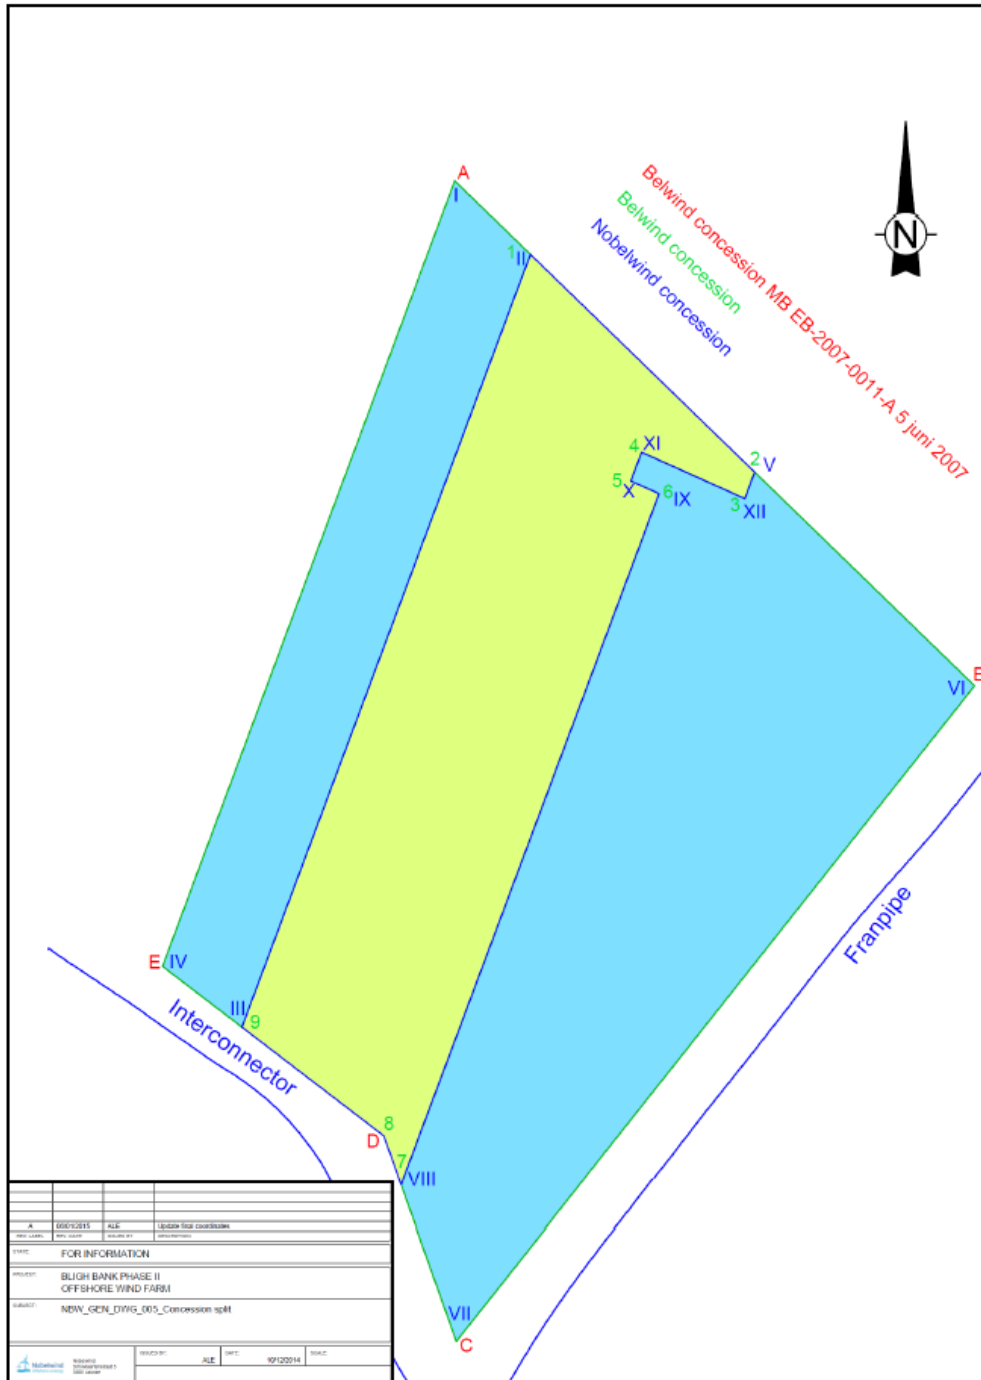

Domain concessions Belwind and Nobelwind

Nobelwind consists of 50 WTG's, type Vestas V112 3.3 MW, total of 165 MW and one Offshore High Voltage Station (OHVS). Via a local grid (33kV) the wind turbines are connected to this OHVS. Further, a 220kV interconnector cable connects this OHVS with the Northwind OHVS. Energy is transported to land via the existing 220kV export cable, installed during the construction of the Northwind project, but the cable owner is now Cableco CVBA. Construction of the Nobelwind project started in 2016. The first energy has been produced since January 2017 and Nobelwind in full production as of May 2017.

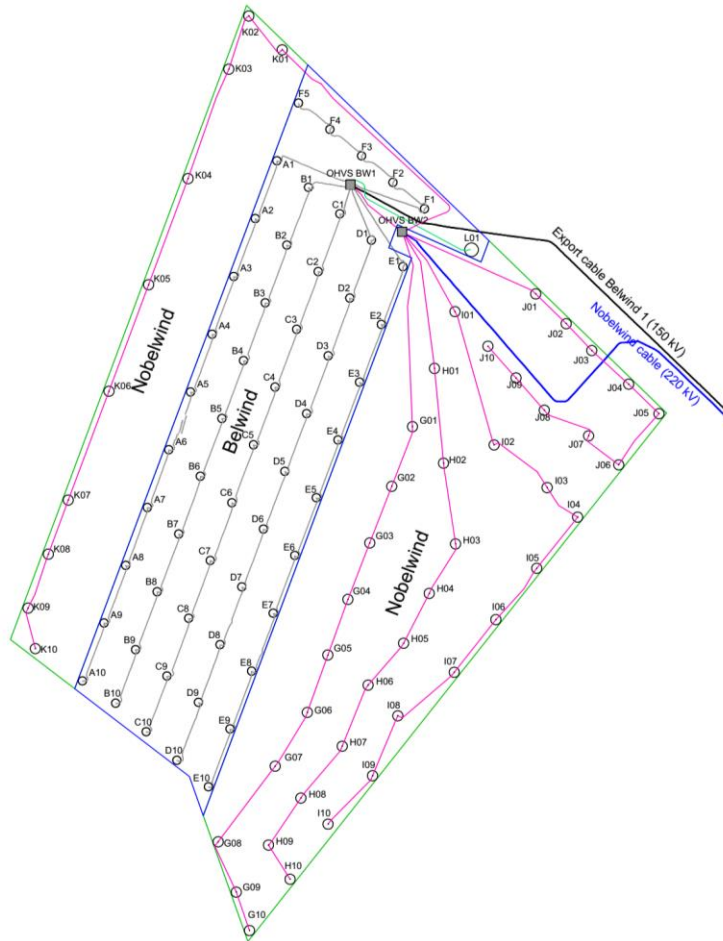

Locations of the Nobelwind and Belwind wind turbines and the grid connection

4. Wind farm annual operations information

Below figures cover the 50 MVOW V112 turbines.


4.1. Production

4.1.1. Performance of the wind farm



Monthly production V112 2021

4.1.2. Wind rose

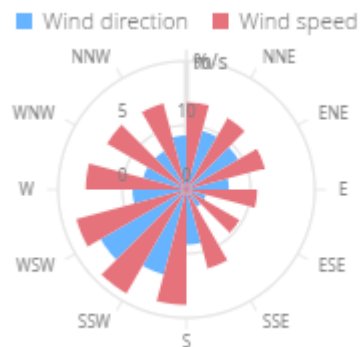

4.2. Planned maintenance

Vestas, the service contractor for the Nobelwind **WTG's**, performed the following planned maintenance and inspections in 2021:

- Vestas did not finish the yearly maintenance within the contractual year but experienced a delay of 3 months on the 4th yearly maintenance. The delay was recovered during the summer without impact. The 5-yearly service started in October and the counter end of December is on 8/50. Mitigation measures have been initiated to avoid a delay in the maintenance.
- Yearly Statutory inspections: 50/50 WTG's completed;
- HV inspections: all WTGs have been inspected;
- GPC inspections were performed on all WTGs along the HV inspections.

On the **electrical installation**, the following tasks have been performed for 2021 as part of the routine maintenance:

- Yearly mandatory statutory inspections of high voltage installation: this inspection was carried out by supplier according to legal criteria and no major observations were made;
- Yearly mandatory statutory inspections of all lifting equipment by supplier: all secondary equipment, cables, chains, slings, hooks and the cranes mechanisms are inspected to see if any aging or damage has occurred to the equipment. An exception has been successfully obtained in 2020 to go from a 3-monthly inspection to a yearly inspection as all lifting equipment is rarely used;
- Yearly maintenance of all equipment by Parkwind: the maintenance focuses on visual inspection, cleaning and functional testing of low voltage systems and components;
- Yearly inspection and maintenance of the fire detection system by supplier: this maintenance campaign focuses on testing of the fire detection equipment and fire control cabinet functions;
- Yearly inspection and maintenance of the firefighting by supplier: this maintenance campaign focuses on the firefighting equipment, e.g. pressure on the firefighting gas and portable fire bottles and test of the release valves and activation push buttons;
- Yearly inspection of First Aid kits;
- 3-monthly maintenances to all SCADA systems and IT infrastructure by Parkwind and supplier: during the SCADA and IT maintenance all equipment is tested and some performance and connectivity tests are performed;
- Yearly maintenance of HVAC installation by supplier: check of filters, functional tests of all valves & sensors, inspection of coolers and cleaning of the heat exchange condensers is performed;
- Yearly inspection of diesel fuel system by Parkwind: general inspection of the diesel generator, pumps and valves are focused during this yearly maintenance. Also, the diesel tank and its leak detection is checked;
- Generator maintenance and load test have been done on a 6-monthly basis to ensure the correct working;
- Yearly inspection of life saving equipment (life jackets and immersion suits) by supplier;
- Yearly inspection life raft by supplier;
- Regularly high and medium voltage equipment checks by Parkwind
- Small preventive maintenance has been done (e.g.: changing defect light bulbs, ...);
- Preventive paint repairs have been performed to avoid excessive corrosion;
- Onshore: Yearly HVAC maintenance has been performed by supplier.

On the **foundations**, the following tasks have been performed in 2021 as part of the routine maintenance:

- Inspection, maintenance and recertification of the fall arrest systems: the complete fall arrest system is inspected and recertified by qualified technicians. If any system is non-compliant it gets replaced as soon as possible;
- Cathodic protection: the cathodic protection needs to prevent/limit the corrosion on the primary and secondary submerged steel. The protection level is continuously monitored through the ICCP SCADA system. The status of the system determines whether offshore interventions are required to control, repair or check the system.
- Survey of inter-array cables: this multibeam survey takes a snapshot of the sea bottom condition and the results are used to determine the depth of burial of the cable assets;

- ROV inspection of outer submerged foundation to evaluate the marine growth and presence of ropes, fishing nets, rocks or other debris;
- Smart foundation monitoring: the WTG's K05, G08 and G10 are equipped with several sensors in order to monitor the grout, loads, and vibrations.
- MP-TP bolted connection: the bolted connection needs to be checked to assure the bolts are tightened to the correct tension, the flange is air-tight, and the bolts are not corroding;
- Frequency monitoring: this monitoring is performed on 20% of the foundations. During half an hour the natural frequencies are measured by accelerometers. These results are analyzed and compared against design frequencies and excitation frequencies caused by blades. This to monitor that natural frequencies are in a safe zone where there is no chance of resonance.
- Nobelwind has stepped into a cable repair framework managed by Parkwind, called Safe Link project. The Safe Link project will ensure that in case of a cable failure, the repair works will be executed within reasonable time to minimize the loss of electricity production, reduce idle time of WTG's and reenergize the cable as soon as possible. To be able to cope with a quick repair, the Safe Link project has been signed with a cable expert contractor and is threefold:
 - Carry out preparedness services = be prepared to mobilize personnel and marine spread + equipment within agreed response time and prepared to carry out the repair works
 - Carry out repair works on the Nobelwind export cable and Inter Array Cables
 - Carry out the spare parts management
 The Safe Link project has an agreement for five year. The preparedness documentation is subject to a yearly review round to implement new working methods and lessons learned.

5. Environmental Research

The MUMM coordinated all the foreseen standard environmental monitoring activities in the field. In collaboration with scientific organizations, some dedicated programs were also started-up in 2017 and further executed by the MUMM whereby Nobelwind cooperates where relevant (e.g. fish track sampling).

6. Permit conditions

In compliance with the authorization for the construction and a license for the operation of a wind farm on the Bligh Bank in the Belgian sea areas article, we give an overview of the environmental permit conditions as mentioned in Schedule 1 of the authorization for the construction and a license for the operation of a wind farm (see Table 2).

Table 2: Permit conditions overview

Condition Number	Condition Summary	Current Status
2	Each planned modification must be reported to the Board and will be included in the annual work report.	No modifications to be reported in 2021.
4	The holder undertakes to find and recover all floating or sunken objects used for its activities which, for any reason, have ended up in the sea during the construction, operation or dismantling stages.	All dropped objects related to Nobelwind offshore activities are recorded in the online reporting tool, the SOS system, and reported on a quarter basis.

Condition Number	Condition Summary	Current Status
14	During construction, all foundations and structures already finished must have a temporary warning light (at the highest point) for shipping and aviation traffic.	No new foundations installed in 2021.
15	The holder must set up the necessary safety systems to assure the signalling of the wind farm and structures at all times.	Since 14 July 2017 all navigation and aviation signalisation are fully operational and monitored.
16	All WTG's must be numbered individually at the base of the mast and at the top of the nacelle.	The foundation and the WTGs have been numbered in accordance with the requirements of this condition.
17	All WTGs and transformers must be provided with collection receptacles to prevent liquids from being released in the environment.	The design of the WTG is such that in case of leakage in the nacelle, all fluids are collected in the central part of the nacelle. From here, collection receptacles are installed under the oil pumps and hydraulic systems as standard.
20	During the operation stage, the availability must be facilitated of a specially equipped intervention vessel (or combination of vessels) for assignments concerning the prevention of shipping traffic accidents and cleaning up sea pollution around and in the wind farm	An agreement was signed with Federal authority responsible for the marine environment.
21	Once or twice a year, the holder must take part in simulated nautical accidents, emergency towing exercises and pollution combating exercises.	On a regular base Nobelwind MVOW execute internal emergency exercises (see 8.2.3 of this report).
24	Before laying protective mattresses or other artificial erosion protection on the seabed, the holder must verify and certify that all components chosen can be used without any danger of leaching into the marine environment. The composition of the erosion protection must be presented to the Board for approval. The use of monoliths and slag is hereby prohibited.	No new construction material to be approved in 2021.
29.1	The construction materials and rip-rap must be made of natural materials and must not contain any waste materials or a secondary raw material... the use of slag is prohibited.	No new construction material to be approved in 2021.
31.2	Pile driving activity between 1 January and 30 April will be subject to additional, special monitoring in the amount of EUR 50,000 at most, which is not included in the estimated budget and is completely at the expense of the holder	No piling activities have been performed in 2021.
33.1	The lighting of the turbines for the benefit of shipping and aviation traffic must comply with the conditions set by the competent authorities.	Lights are installed according to the Navigational Aids Plan and have been fully operational in the O&M reporting period. Since Nobelwind is built around Belwind, the Navigational Aids Plan of Belwind has been changed into a Navigational Aids Plan of the Bligh Bank, considering the whole zone of Belwind and Nobelwind as one zone.
33.2	Foghorns, which come into operation automatically in the event of a meteorological visibility of less than 2 sea miles, must be placed on the corner turbines.	Fog horns are installed according to the Navigational Aids plan and have been fully operational in the O&M reporting period.

Condition Number	Condition Summary	Current Status
34	The holder must maintain the farm on a regular basis.	All installations are maintained on a regular basis.
35.4	The covering of the cables must be assured at all times. If the annual monitoring shows that the cable is exposed, the necessary work must be done in the shortest possible time, three months at most, so that the cable can be placed at its original depth.	Annual cable burial depth surveys are executed during the operational phase. Based on the result of the cable risk analysis (Cable Risk Management), a reburial campaign will be set up.
48	A logbook must be kept in which the following is specified for each turbine: <ul style="list-style-type: none"> ➤ Date, time and all relevant data of incidents that occur which have an impact of the environment, stating the measures taken; and ➤ The recording of hazardous waste materials, the date of removal of the relevant batch of waste, the quantity and the name of the carrier and the recognised waste processor must also be recorded. 	We confirm that logbooks have been kept for all turbines since start-up of the first WTG and this has continued during operation.

7. Operations Management

7.1. Health Safety and environment

7.1.1. Unwanted events over the reporting period

No unwanted events (LTI) happened during the reporting period.

7.1.2. Proactive safety initiatives

To ensure that our O&M employees continue their good progress of recent years, the company decided to establish a KPI for 2021 that combined the KPIs of previous years:

1. Identically to 2018, 2019 and 2020 we continued to encourage both our own employees and Contractor personnel to report all hazard observations, near misses, incidents, first aid cases and opportunities for improvement using the online "SoS" reporting system. For O&M personnel a KPI was set on the reporting of unwanted events in SoS for both on- and offshore locations.
2. A second KPI was set on the O&M Team's revision of existing risks assessments and the preparation of risk assessments of activities not yet appropriately risk assessed.
3. A third KPI was set on the execution of workplace inspections (WPI).

To provide our employees and Contractors with a better understanding of our HSSE procedures and requirements, additional online inductions were developed, and existing inductions were updated in our Online learning platform. The Online learning platform is linked to the online "SoS" reporting system this to make sure that training certificates and induction certificates of both our employees and contractors are followed up on.

In the light of the current Covid 19 pandemic, the HSSE Team, together with the O&M team took all appropriate measures, in line with legal requirements, to prevent the spread of Covid 19 during work-related activities, both on- and offshore, and implemented necessary procedures on the management of possible and confirmed infection cases. The measures included, but were not limited to:

- Use of facemasks;
- Fixed team constellations;
- Social distancing in both offices and vessels (limited PAX);
- Rapid-testing, self-testing and PCR-testing;
- Distribution of personal sanitation means;
- Self-Health declarations;
- Contact tracing;
- Etc.

7.1.3. Emergency exercises


Overview emergency exercises 2021	
WTG	20/03/2021: Contractor : Elevator Self Rescue Exercise
	22/03/2021: Contractor : RON, Inside Tower Sked rescue and TP evacuation
OHVS	21/04/2021: Parkwind: Safety exercise OHVS rescue
	23/06/2021: Parkwind: Fire drill
	13/07/2021: Parkwind: Safety exercise NBW OHVS SALA
Onshore	17/01/2021: Contractor : Oil leakage (gearbox oil)
Environment	20/10/2021: The Authorities organized a Pollution Exercise (POLEX) in Nobelwind-Seastar but the offshore part of the exercise was cancelled due to weather conditions. The exercise shall be rescheduled in 2022.

7.1.4. Emergency actions (TIER2)

In 2021 there was one Tier 2 situation reported.

7.1.5. Intrusions

In 2021 we had 4 intrusions reported on the Nobelwind concession:

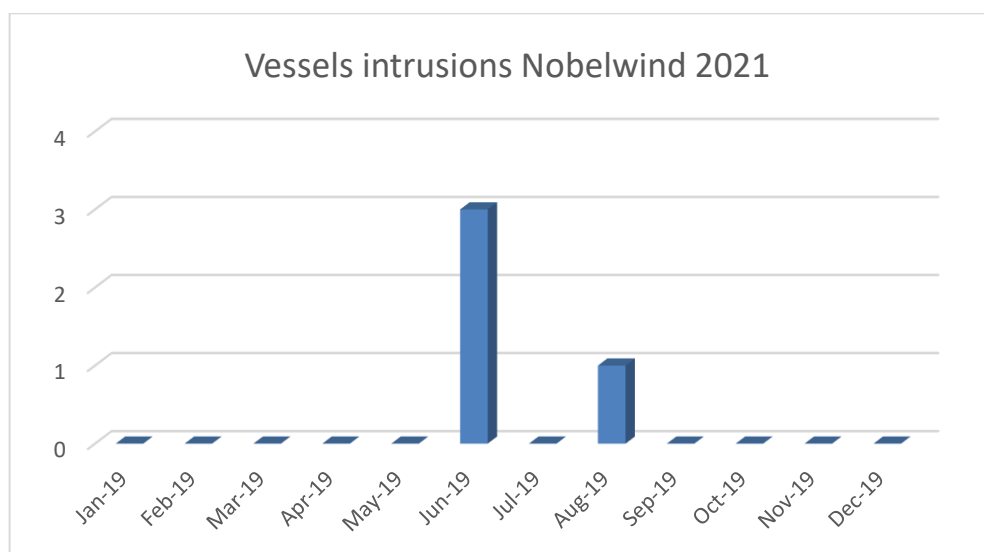

Overview intrusions 2021

As the intrusions were related to activities of neighbouring windfarms and only included small crossings of the safety zone (Proximity Agreement), these intrusions were managed between Nobelwind Marine Coordinator and the Marine Coordinators of the applicable neighbouring wind parks. Thus, these intrusions were not reported towards the Authorities, using the MRCC intrusion template.

All intrusions are logged in the SOS system and are during the periodic Supervisory Committee meetings communicated to the Authorities. In case of intrusions by civilians (e.g. fishing boats) the MRCC template is used to report towards the Authorities; considered a TIER situation.

7.2. Vessel & accessibility

For maintenance on the turbines the Esvagt Supporter (in December 2017 replaced by the Esvagt Mercator) is used as hotel/mother ship. Small crew transfer crafts, FRC's, are being used for transfer of personal, tools and equipment on the wind turbines, as well as for maintenance on the OHVS and the foundations, for delivery of parts and equipment to the wind farm and for carrying out surveys and measurement campaigns.

7.3. O&M office Parkwind

O&M team offices are located in the harbor of Ostend:
Esplanadestraat 10B
8400 Oostende

8. Conclusion and outlook

On average, 2021 has been a low wind year and was below the expected (long term) wind resource.

We are happy to report that no big QHSSE incidents have to be recorded and that all tasks as mentioned under the operational permits are well managed. The only Tier 2 incident was the result of a miscommunication. We foresee a further rolling out of the HSSE master plan in 2021 supported by the Parkwind HSSE team.

The maintenance routine on all aspects (WTG, civil and electrical) was carried out. With the correct lessons learned implemented in both scheduled and unscheduled tasks, the maintenance routine has continued in 2021 without any major surprises.

Nobelwind keeps striving for innovation in terms of maintenance procedures, preventive actions, O&M inspection tools, etc. as it has been doing in the past. Nobelwind is performing extremely well and the maintenance inspections show clearly that many improvements have been incorporated in the design and construction routines to allow for a lean maintenance approach. With a strong managing contractor as Parkwind, we are confident that this approach is further implemented during the operational phase and that any concern that may rise can be tackled adequately and preferably in a proactive matter.